



Tesla Powerwall 3 & PV Label Kit

Tesla Powerwall 3 & PV Label Kit – 3 String

SKU: T-PW3-PV-KIT

PV DP and ES3480 Sticker Default, None, PV DP and ES3480 Sticker Default, Vinyl Sticker, PV DP and ES3480 Sticker Default, Polypropylene Label (Masonry), PV DP and ES3480 Traffolyte Label, None, PV DP and ES3480 Traffolyte Label, Vinyl Sticker, PV DP and ES3480 Traffolyte Label, Polypropylene Label (Masonry)


Price: \$30.75 ex-GST

Stock: instock

Tags: [Kits](#)

Product Description

Tesla Powerwall 3 & PV Label Kit - 3 String

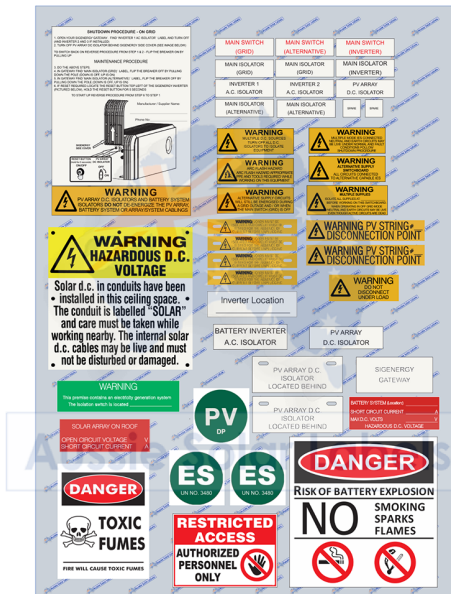

Sigenergy label kit – Three Phase

Multiple Kit options

SKU: 5150-01K00

Price: \$45.00 ex-GST

Stock: instock

Tags: [Kits](#)

Product Description

0984 1 Shutdown Procedure – On Grid 0985 1 Warning Battery System D.C. Isolators do not De-Energise the Battery 0032 1 PV DP Green Reflective Fire Sign 100mm Dia 0069 2 ES Un No: 3480 Green Reflective Fire Sign 100mm Dia 0774 1 SIGENERGY Gateway 0773 2 PV Array D.C. Isolator located behind 0821 1 Warning Multiple Supplies isolated all supplies before “Switchboard” 0156 1 Battery System Location, Short Circuit / Max D.C. Volts 0031 1 Inverter Location 0363 2 Warning PV String Disconnection Point 0716 4 Warning Loads must be isolated circuits must be tested for the absence 0780 1 Main Switch (GRID) 0781 1 Main Switch (ALTERNATIVE) 0782 1 Main Switch (INVERTER) 0772 2 Main Isolator (GRID) 0771 2 Main Isolator (ALTERNATIVE) 0783 1 Main Isolator (INVERTER) 0770 2 PV Array D.C. Isolator 0768 1 Inverter 1

A.C. Isolator 0769 1 Inverter 2 A.C. Isolator 0767 2 Spare 0131 1 Danger Toxic Fumes 0043 1 Warning Hazardous D.C. Voltage Solar D. C in conduits have been install 0129 1 Danger Risk of Battery Explosion 0287 1 Restricted Access Authorised personnel only 0752 1 Warning Do not disconnect under load 0724 1 Warning Multiple mode IES connected 0733 1 Warning ARC Flash Hazard 0035 1 Warning This Premise contains an electricity generation system 0019 1 Solar Array on roof 0812 1 Battery Inverter A.C. Isolator 0720 1 Warning Multiple DC Sources "Equipment" 0844 1 Warning Alternative Supply Circuits will still be energised 0846 1 Warning Alternative Supply Switchboard



PV SW System Label Kit NSW (with roof top isolators) with in-ceiling polypropylene label

14 piece NSW Label Kit AS/NZ 5033:2021

SKU:

Price: \$16.68 ex-GST

Stock: instock

Tags: [Kits](#), [NSW](#), [Polypropylene](#)

Product Description

PV SW System Label Kit NSW (with roof top isolators) with in-ceiling polypropylene label SKU: 5018
Kit Contents: [1x In-Ceiling Polypropylene Label \(pre-cut holes x7\)](#) SKU: 0043 [1x Solar Array on Roof V A](#) SKU: 0019 [1x Warning Multiple Supplies Switchboard](#) SKU: 0020 [1x Warning Hazardous D.C. Voltage](#) SKU: 0022 [1x Main Switch Grid supply \(white\)](#) SKU: 0060 [1x Main Switch Inverter Supply \(white\)](#) SKU: 0061 [2x PV Array D.C. Isolator](#) SKU: 0029 [1x Inverter A.C. Isolator](#) SKU: 0030 [1x Inverter Location](#) SKU: 0031 [1x PV SW Green Reflective Fire Sign 100mm Dia \(Sticker\)](#) SKU: 0033 [1x Shutdown Procedure](#) SKU: 0037 [1x Warning Multiple D.C. Sources Equipment](#) SKU: 0040 [1x Warning PV Array DC Isolators do not de-energise the PV array and Array Cabling](#) SKU: 0047



Solar d.c. In conduits have been installed (In Ceiling space or accessible floor space)

2 piece In Ceiling Kit with 9 pre-cut holes

SKU: 5014

Price: \$6.18 ex-GST

Stock: instock

Tags: [Kits](#)

Product Description

In-Ceiling space or accessible floor space Solar d.c sign & Warning Hazardous DC Voltage kit SKU: 5014 240x180mm Kit Contents: **SKU:0018** Solar d.c. In conduits have been installed (In Ceiling space or accessible floor space) 9 pre-cut holes **SKU:0003** [1x Warning Hazardous DC Voltage \(2 pre-cut holes\)](#)



PV SW System Label Kit ACT (with roof top isolators)

13 piece ACT Label Kit AS/NZ 5033:2021

SKU:

Price: \$13.13 ex-GST


Stock: instock

Tags: [ACT](#), [Kits](#)

Product Description

PV SW System Label Kit ACT (with roof top isolators) SKU: 5025 Kit Contents: [1x Solar Array on Roof V A](#) [SKU: 0019](#) [1x Warning Multiple Supplies Switchboard](#) [SKU: 0020](#) [1x Warning Hazardous D.C. Voltage](#) [SKU: 0022](#) [1x Main Switch Grid supply \(white\)](#) [SKU: 0060](#) [1x Main Switch Inverter Supply \(white\)](#) [SKU: 0061](#) [2x PV Array D.C. Isolator](#) [SKU: 0029](#) [1x Inverter A.C. Isolator](#) [SKU: 0030](#) [1x Inverter Location](#) [SKU: 0031](#) [1x PV SW 100mm Dia \(Traffolyte\)](#) [SKU: 0063](#) [1x Shutdown Procedure](#) [SKU: 0037](#) [1x Warning Multiple D.C. Sources Equipment](#) [SKU: 0040](#) [1x Warning PV Array DC Isolators](#)

[do not de-energise the PV array and Array Cabling](#) [SKU: 0047](#)

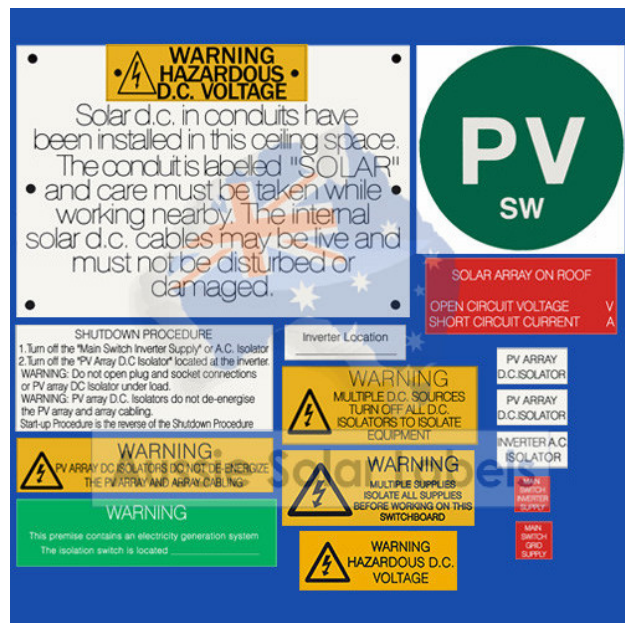

PV SW System Label Kit Victoria (with roof top isolators) with in-ceiling traffolyte label

16 piece Victoria Label Kit AS/NZ 5033:2021

SKU:

Price: \$18.04 ex-GST

Stock: instock

Tags: [Kits](#), [Victoria](#)

Product Description

PV SW System Label Kit Victoria (with roof top isolators) with in-ceiling traffolyte label **SKU: 5017** Kit

Contents: [1x In-Ceiling space or accessible floor space solar d.c. in conduit](#) [SKU: 0024](#) [1x Warning Hazardous DC Voltage \(pre-cut hole x2\)](#) [SKU: 0003](#) [1x Solar Array on Roof V A](#) [SKU: 0019](#) [1x Warning Multiple Supplies Switchboard](#) [SKU: 0020](#) [1x Warning Hazardous D.C. Voltage](#) [SKU: 0022](#) [1x Main Switch Inverter Supply \(red\)](#) [SKU: 0027](#) [1x Main Switch Grid supply \(red\)](#) [SKU: 0028](#) [2x PV Array D.C. Isolator](#) [SKU: 0029](#) [1x Inverter A.C. Isolator](#) [SKU: 0030](#) [1x Inverter Location](#) [SKU: 0031](#) [1x PV SW 100mm Dia \(Sticker\)](#) [SKU: 0033](#) [1x Warning This premise contains an electricity generation system](#) [SKU: 0035](#) [1x Shutdown Procedure](#) [SKU: 0037](#) [1x Warning Multiple D.C. Sources Equipment](#) [SKU: 0040](#) [1x Warning PV Array DC Isolators do not de-energise the PV array and Array Cabling](#) [SKU: 0047](#)



DC Label Kit 2021 Upgrade ACT


SKU: 5006

Price: \$13.18 ex-GST

Stock: instock

Product Description

Contents: 1x In Ceiling space or accessible floor space Solar d.c sign 4 x Disconnection Points, with cable ties 1 x [PV DP Green Traffolyte Label 100mm Dia](#) 2 x Warning - PV String Disconnection Points

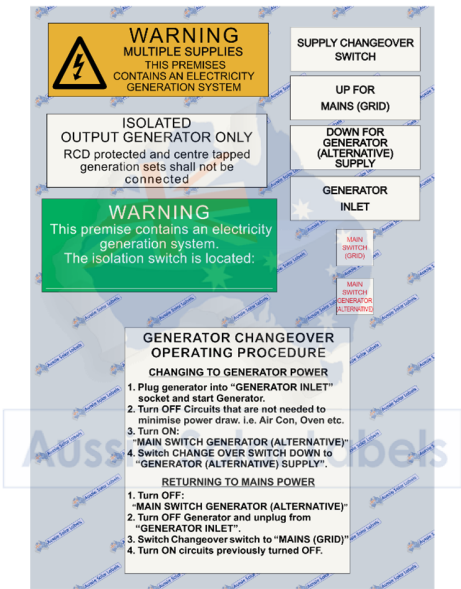

Generator LabelKit


Multiple Kit options

SKU: 5151-01 | 5152-01
Single Phase, Three Phase

Price: \$14.00 ex-GST
Stock: instock
Tags: [Kits](#)

Product Description

GENERATOR LABELKIT- SINGLE PHASE Single phase generator Change over label kit with operating instructions ASL: Sku: No: 5151-01 1005 90x100 1 Generator changeover operating procedure 1000 96x38 1 Warning this premise contains an electricity generation system 0552 90x30 1 Warning multiple supplies 0555 90x30 1 Isolated output generator only 0995 53x18 1 Supply change over switch 0996 53x18 1 Up for mains (GRID) 0997 53x18 1 Down for Generator (ALTERNATIVE) supply 0998 53x18 1 Generator inlet 0721 18x18 1 Main Switch (GRID) 0999 18x18 1 Main Switch generator (ALTERNATIVE) **GENERATOR LABELKIT- THREE PHASE** Three phase generator Change over label kit with operating instructions ASL: Sku: No: 5152-01 1005 90x100 1 Generator changeover operating procedure 1000 96x38 1 Warning this premise contains an electricity generation system 0552 90x30 1 Warning multiple supplies 0555 90x30 1 Isolated output generator only 0995 53x18 1 Supply change over switch 0996 53x18 1 Up for mains (GRID) 0997 53x18 1 Down for Generator (ALTERNATIVE) supply 0998 53x18 1 Generator inlet 0780 53x18 1 Main Switch (GRID) 1001 53x18 1 Main Switch generator (ALTERNATIVE)

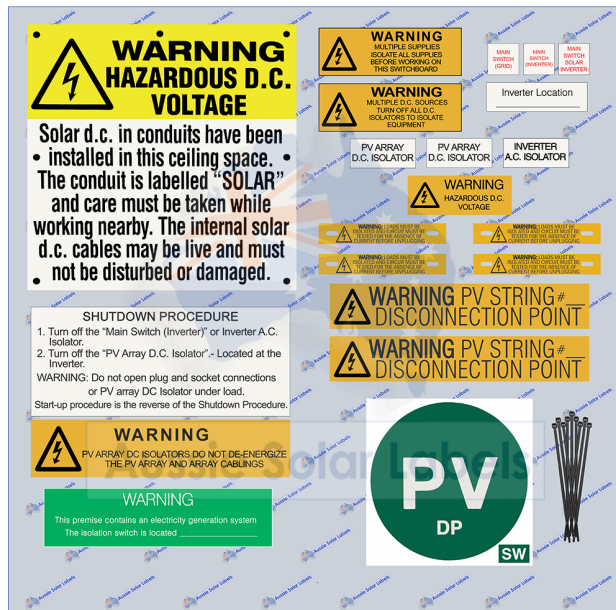

PV DP System Label Kit - including SW Sticker

Multiple Kit options

SKU: 5126-01

shutdown-procedure-basic, polypropylene-in-ceiling, pv-dp-sticker, none, shutdown-procedure-basic, polypropylene-in-ceiling, pv-dp-sticker, vinyl-map, shutdown-procedure-basic, polypropylene-in-ceiling, pv-dp-sticker, polypropylene-map, shutdown-procedure-basic, polypropylene-in-ceiling, pv-dp-traffolyte-label, none, shutdown-procedure-basic, polypropylene-in-ceiling, pv-dp-traffolyte-label, vinyl-map, shutdown-procedure-basic, polypropylene-in-ceiling, pv-dp-traffolyte-label, polypropylene-map, shutdown-procedure-basic, traffolyte-in-ceiling, pv-dp-sticker, none, shutdown-procedure-basic, traffolyte-in-ceiling, pv-dp-sticker, vinyl-map, shutdown-procedure-basic, traffolyte-in-ceiling, pv-dp-sticker, polypropylene-map, shutdown-procedure-basic, traffolyte-in-ceiling, pv-dp-traffolyte-label, none, shutdown-procedure-basic, traffolyte-in-ceiling, pv-dp-traffolyte-label, vinyl-map, shutdown-procedure-basic, traffolyte-in-ceiling, pv-dp-traffolyte-label, polypropylene-map, shutdown-procedure-deluxe, polypropylene-in-ceiling, pv-dp-sticker, none, shutdown-procedure-deluxe, polypropylene-in-ceiling, pv-dp-sticker, vinyl-map, shutdown-procedure-deluxe, polypropylene-in-ceiling, pv-dp-sticker, polypropylene-map, shutdown-procedure-deluxe, polypropylene-in-ceiling, pv-dp-traffolyte-label, none, shutdown-procedure-deluxe, polypropylene-in-ceiling, pv-dp-traffolyte-label, vinyl-map, shutdown-procedure-deluxe, polypropylene-in-ceiling, pv-dp-traffolyte-label, polypropylene-map, shutdown-procedure-deluxe, traffolyte-in-ceiling, pv-dp-sticker, none, shutdown-procedure-deluxe, traffolyte-in-ceiling, pv-dp-sticker, vinyl-map, shutdown-procedure-deluxe, traffolyte-in-ceiling, pv-dp-sticker, polypropylene-map, shutdown-procedure-deluxe, traffolyte-in-ceiling, pv-dp-traffolyte-label, none, shutdown-procedure-deluxe, traffolyte-in-ceiling, pv-dp-traffolyte-label, vinyl-map, shutdown-procedure-deluxe, traffolyte-in-ceiling, pv-dp-traffolyte-label, polypropylene-map

Price: \$16.45 ex-GST

Stock: instock

Tags: [Kits](#)



Commercial Label Kit

Kit contains 21 labels

SKU: 5094

Price: \$28.00 ex-GST

Stock: instock

Tags: [Kits](#)

Product Description

Commercial Label Kit SKU:5094 Kit contains 20 labels: SKU:0498 Solar system Shutdown Procedure No 1 SKU:0499 Solar system Shutdown Procedure No 2 SKU:0047 Warning PV Array DC Isolators do not De Energise the PV Array & Array Cablings SKU:0032 PV DP Sticker SKU:0492 Solar Array Location, V / A SKU:0493 PV Array Isolation Box SKU:0494 Solar SKU:0495 Solar Supply SKU:0496 A.C. Solar Array SKU:0497 Warning Hazardous DC Voltage do not Withdraw Fuse when under Load SKU:0020 Warning Multiple Supplies Isolate all supplies before working on this Switchboard SKU:0040 Warning Multiple DC Sources Turn off all DC Isolators to isolate Equipment SKU:0089 Warning Hazardous DC Voltage Authorised Access Only SKU:0022 Warning Hazardous DC Voltage SKU:0029 PV Array DC Isolator SKU:0030 Inverter Ac Isolator SKU:0061 Main Switch Inverter Supply SKU:0060 Main Switch grid Supply



PV SW System Label Kit

Multiple Kit options and Optional PV (Solar) Site Information Map

SKU: 5015 | 5020

excluding-nsw-act, none, act-nsw, none, excluding-nsw-act, vinyl-map, act-nsw, vinyl-map, excluding-nsw-act, polypropylene-map, act-nsw, polypropylene-map

Price: \$11.15 ex-GST


Stock: instock

Tags: [ACT](#), [Kits](#), [NSW](#), [QLD](#), [SA](#), [Victoria](#), [WA](#)

Product Description

PV SW System Label Kit SKU:5015 13 piece kit (VIC, QLD, WA, SA, TAS & NT) SKU:5020 12 piece kit

(ACT & NSW) **Option to add PV (Solar) Site Information Map & Icon sticker Kit** 2 piece, 250x175mm SKU:5085 Polypropylene with 4 pre-cut holes and Icons sticker set SKU:5086 Sticker(Vinyl decal) and Icons sticker set **Kit contains:** SKU:0020 Warning Multiple Supplies Switchboard SKU:0022 Warning Hazardous D.C. Voltage SKU:0027 & SKU:0061 Main Switch Inverter Supply SKU:0028 & SKU:0060 Main Switch Grid supply SKU:0029 PV Array D.C. Isolator SKU:0030 Inverter A.C. Isolator SKU:0031 Inverter Location SKU:0033 PV SW 100mm Dia (Sticker) SKU:0035 Warning This premise contains an electricity generation system SKU:0037 Shutdown Procedure SKU:0040 Warning Multiple D.C. Sources Equipment SKU:0047 Warning PV Array DC Isolators do not de-energise the PV array and Array Cabling

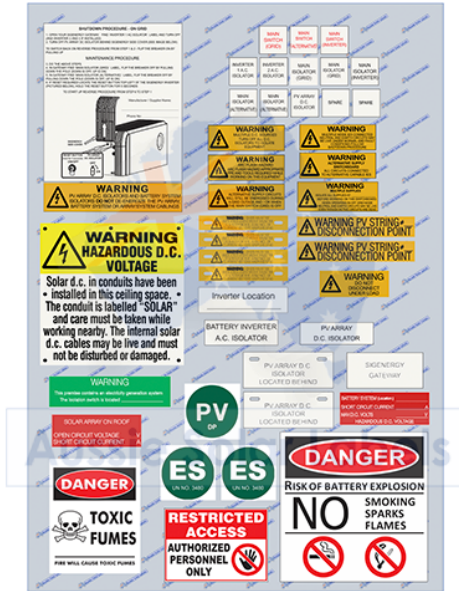

Sigenergy label kit – Single Phase

Multiple Kit options

SKU: 5149-01K00

Price: \$42.00 ex-GST

Stock: instock

Tags: [Kits](#)

Product Description

0984 1 Shutdown Procedure – On Grid 0985 1 Warning Battery System D.C. Isolators do not De-Energise the Battery 0032 1 PV DP Green Reflective Fire Sign 100mm Dia 0069 2 ES Un No: 3480 Green Reflective Fire Sign 100mm Dia 0774 1 SIGENERGY Gateway 0773 2 PV Array D.C. Isolator located behind 0821 1 Warning Multiple Supplies isolated all supplies before “Switchboard” 0156 1 Battery System Location, Short Circuit / Max D.C. Volts 0031 1 Inverter Location 0363 2 Warning PV String Disconnection Point 0716 4 Warning Loads must be isolated circuits must be tested for the absence 0721 1 Main Switch (GRID) 0727 1 Main Switch (ALTERNATIVE) 0722 1 Main Switch (INVERTER) 0731 2 Main Isolator (GRID) 0766 2 Main Isolator (ALTERNATIVE) 0784 1 Main Isolator (INVERTER) 0777 1 PV Array D.C. Isolator 0775 1 Inverter 1 A.C. Isolator 0776 1 Inverter 2 A.C. Isolator 0767 2 Spare 0131 1 Danger Toxic Fumes 0043 1 Warning Hazardous D.C. Voltage Solar D. C in conduits have been install 0129 1 Danger Risk of Battery Explosion 0287 1 Restricted Access Authorised personnel only 0752 1 Warning Do not disconnect under load 0724 1 Warning Multiple mode IES connected 0733 1 Warning ARC Flash Hazard 0035 1 Warning This Premise contains an electricity generation system 0019 1 Solar Array on roof 0770 1 PV Array D.C. Isolator 0812 1 Battery Inverter A.C. Isolator 0720 1 Warning Multiple DC Sources “Equipment” 0844 1 Warning Alternative Supply Circuits will still be energised 0846 1 Warning Alternative Supply Switchboard



Solar d.c. in conduits have been installed in this ceiling space. The conduit is labelled "SOLAR" and care must be taken while working nearby. The internal solar d.c. cables may be live and must not be disturbed or damaged.



DC Label Kit 2021 Upgrade (all States excl. ACT)

51 - 100 \$13.80 101 or 250 \$13.05 500+ Call for price

SKU: 5005


Price: \$13.18 ex-GST

Stock: instock

Tags: [Kits](#)

Product Description

DC Label Kit 2021 Upgrade (all States excl. ACT) SKU:5005 **Contents:** 1x In Ceiling space or accessible floor space Solar d.c sign 4 x Disconnection Points, with cable ties 1 x PV DP Label Dia 100mm 2 x Warning – PV String Disconnection Points

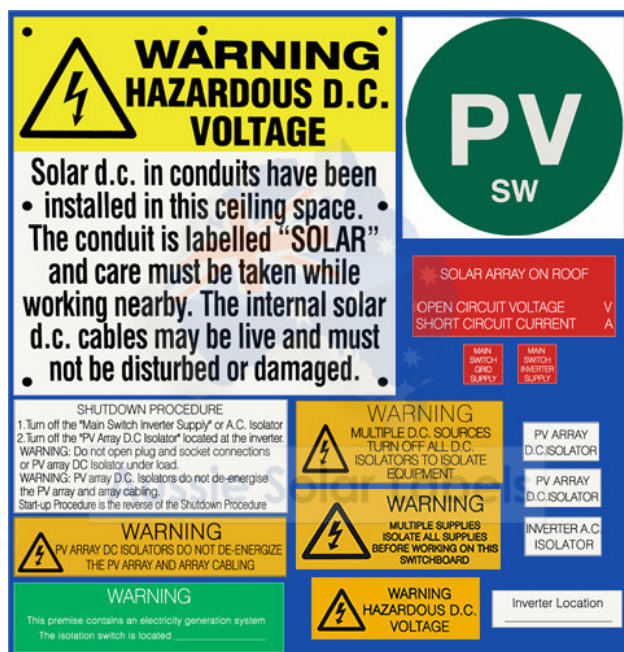

PV SW System Label Kit Victoria (with roof top isolators) with in-ceiling polypropylene label

15 piece Victoria Label Kit AS/NZ 5033:2021

SKU: 5016

Price: \$16.68 ex-GST


Stock: instock

Tags: [Kits](#), [Polypropylene](#), [Victoria](#)

Product Description

PV SW System Label Kit Victoria (with roof top isolators) with in-ceiling polypropylene label SKU: 5016 **Kit Contents:** [1x In-Ceiling Polypropylene Label \(pre-cut holes x7\)](#) SKU: 0043 [1x Solar Array on Roof V A](#) SKU: 0019 [1x Warning Multiple Supplies Switchboard](#) SKU: 0020 [1x Warning Hazardous D.C. Voltage](#) SKU: 0022 [1x Main Switch Inverter Supply \(red\)](#) SKU: 0027 [1x Main Switch Grid supply \(red\)](#) SKU: 0028 [2x PV Array D.C. Isolator](#) SKU: 0029 [1x Inverter A.C. Isolator](#) SKU: 0030 [1x Inverter Location](#) SKU: 0031 [1x PV SW 100mm Dia \(Sticker\)](#) SKU: 0033 [1x Warning This premise contains an](#)

[electricity generation system SKU: 0035](#) [1x Shutdown Procedure SKU: 0037](#) [1x Warning Multiple D.C. Sources Equipment SKU: 0040](#) [1x Warning PV Array DC Isolators do not de-energise the PV array and Array Cabling SKU: 0047](#)

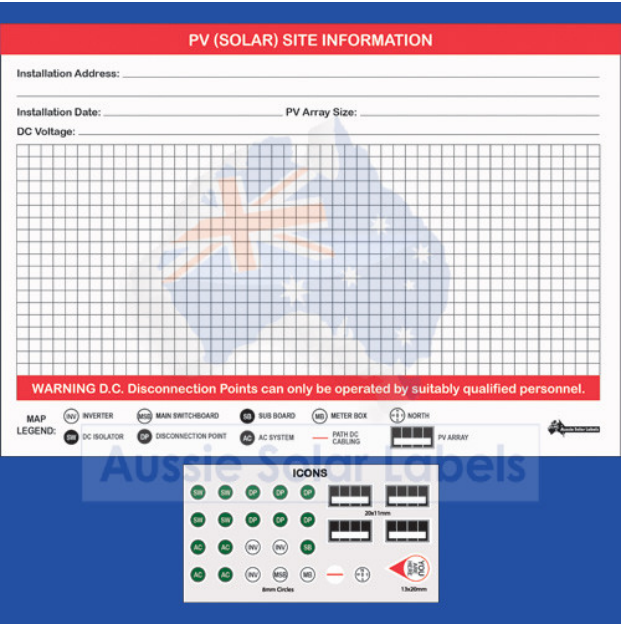

PV (Solar) Site Information Map & Icon sticker Kit


2 piece Options of Sticker(Vinyl decal) or Polypropylene with 4 pre-cut holes

SKU: 5085 | 5086
vinyl, polypropylene

Price: \$3.41 ex-GST
Stock: instock
Tags: [ACT](#), [Kits](#), [NSW](#), [QLD](#), [SA](#), [Victoria](#), [WA](#)

Product Description

PV (Solar) Site Information Map & Icon sticker Kit 2 piece 250x175mm **SKU:5085** Polypropylene with 4 pre-cut holes and Icons sticker set **SKU:5086** Sticker(Vinyl decal) and Icons sticker set

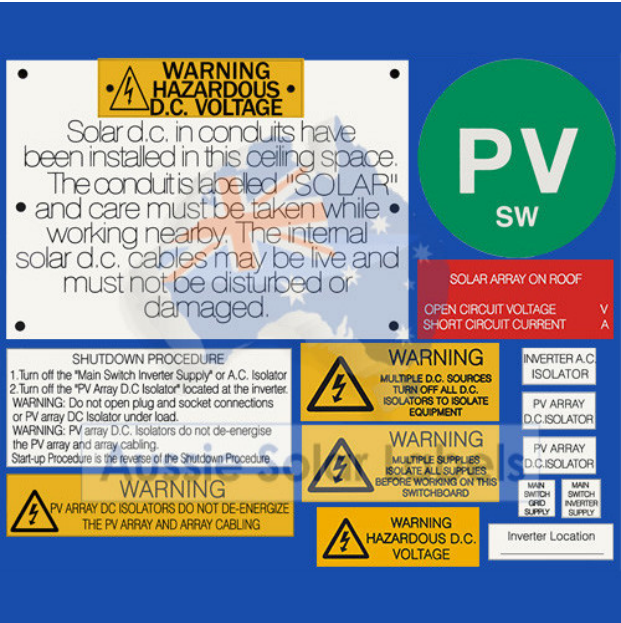

PV SW System Label Kit ACT (with roof top isolators) with in-ceiling traffolyte label

15 piece ACT Label Kit AS/NZ 5033:2021
SKU:

Price: \$18.04 ex-GST
Stock: instock
Tags: [ACT](#), [Kits](#)

Product Description

PV SW System Label Kit ACT (with roof top isolators) with in-ceiling traffolyte label **SKU: 5024** Kit **Contents:** 1x In-Ceiling space or accessible floor space solar d.c. in conduit (*not sold separately*) **SKU: 0024** [1x Warning Hazardous DC Voltage \(pre-cut hole x2\) SKU: 0003](#) [1x Solar Array on Roof V A SKU:](#)

[0019 1x Warning Multiple Supplies Switchboard](#) [SKU: 0020 1x Warning Hazardous D.C. Voltage](#) [SKU: 0022 1x Main Switch Grid supply \(white\)](#) [SKU: 0060 1x Main Switch Inverter Supply \(white\)](#) [SKU: 0061 2x PV Array D.C. Isolator](#) [SKU: 0029 1x Inverter A.C. Isolator](#) [SKU: 0030 1x Inverter Location](#) [SKU: 0031 1x PV SW 100mm Dia \(Traffolyte\)](#) [SKU: 0063 1x Shutdown Procedure](#) [SKU: 0037 1x Warning Multiple D.C. Sources Equipment](#) [SKU: 0040 1x Warning PV Array DC Isolators do not de-energise the PV array and Array Cabling](#) [SKU: 0047](#)



PV SW System Label Kit QLD / WA / SA (with roof top isolators) with in-ceiling polypropylene label

14 piece QLD / WA / SA Label Kit AS/NZ 5033:2021

SKU:

Price: \$16.68 ex-GST


Stock: instock

Tags: [Kits](#), [Polypropylene](#), [QLD](#), [SA](#), [WA](#)

Product Description

PV SW System Label Kit QLD / WA / SA (with roof top isolators) with in-ceiling polypropylene label

SKU: 5022 Kit Contents: [1x In-Ceiling Polypropylene Label \(pre-cut holes x7\)](#) [SKU: 0043 1x Solar Array on Roof V A](#) [SKU: 0019 1x Warning Multiple Supplies Switchboard](#) [SKU: 0020 1x Warning Hazardous D.C. Voltage](#) [SKU: 0022 1x Main Switch Inverter Supply \(red\)](#) [SKU: 0027 1x Main Switch Grid supply \(red\)](#) [SKU: 0028 2x PV Array D.C. Isolator](#) [SKU: 0029 1x Inverter A.C. Isolator](#) [SKU: 0030 1x Inverter Location](#) [SKU: 0031 1x PV SW 100mm Dia \(Sticker\)](#) [SKU: 0033 1x Shutdown Procedure](#) [SKU: 0037 1x Warning Multiple D.C. Sources Equipment](#) [SKU: 0040 1x Warning PV Array DC Isolators do not de-energise the PV array and Array Cabling](#) [SKU: 0047](#)

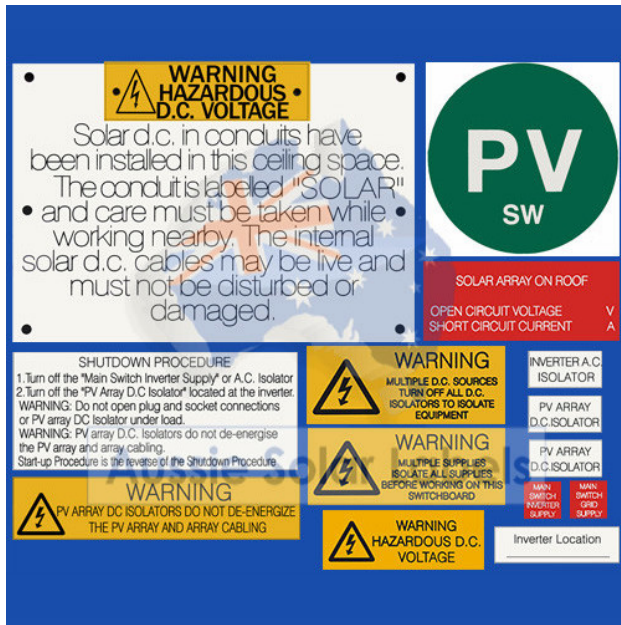

PV SW System Label Kit QLD / WA / SA (with roof top isolators) with in-ceiling traffolyte label

15 piece QLD / WA / SA Label Kit AS/NZ 5033:2021

SKU:


Price: \$18.04 ex-GST

Stock: instock

Tags: [Kits](#), [QLD](#), [SA](#), [WA](#)

Product Description

PV SW System Label Kit QLD / WA / SA (with roof top isolators) with in-ceiling traffolyte label SKU: 5023
Kit Contents: [1x In-Ceiling space or accessible floor space solar d.c. in conduit](#) SKU: 0024 [1x Warning Hazardous DC Voltage \(pre-cut hole x2\)](#) SKU: 0003 [1x Solar Array on Roof V A](#) SKU: 0019 [1x Warning Multiple Supplies Switchboard](#) SKU: 0020 [1x Warning Hazardous D.C. Voltage](#) SKU: 0022 [1x Main Switch Inverter Supply \(red\)](#) SKU: 0027 [1x Main Switch Grid supply \(red\)](#) SKU: 0028 [2x PV Array D.C. Isolator](#) SKU: 0029 [1x Inverter A.C. Isolator](#) SKU: 0030 [1x Inverter Location](#) SKU: 0031 [1x PV SW 100mm Dia \(Sticker\)](#) SKU: 0033 [1x Shutdown Procedure](#) SKU: 0037 [1x Warning Multiple D.C. Sources Equipment](#) SKU: 0040 [1x Warning PV Array DC Isolators do not de-energise the PV array and Array Cabling](#) SKU: 0047

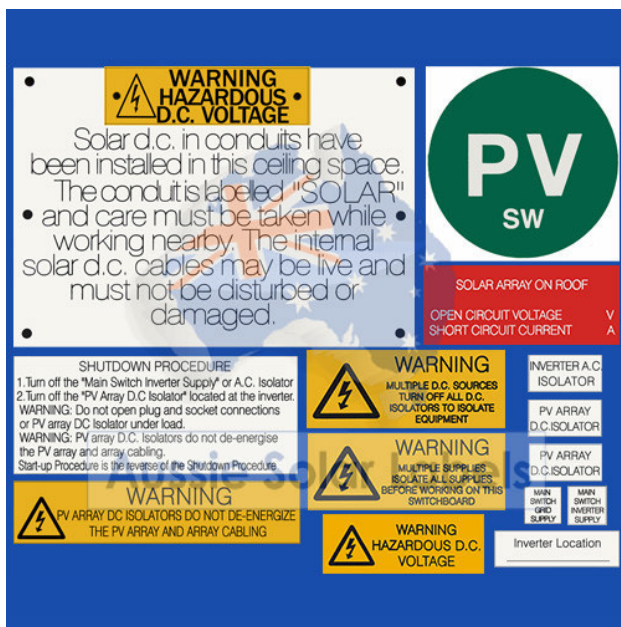

PV SW System Label Kit NSW (with roof top isolators) with in-ceiling traffolyte label

15 piece NSW Label Kit AS/NZ 5033:2021

SKU: 5019

Price: \$18.04 ex-GST

Stock: instock

Tags: [Kits](#), [NSW](#)

Product Description

PV SW System Label Kit NSW (with roof top isolators) with in-ceiling traffolyte label SKU: 5019 Kit

Contents: 1x In-Ceiling space or accessible floor space solar d.c. in conduit *(not sold separately)* SKU: 0024 1x Warning Hazardous DC Voltage (pre-cut hole x2) SKU: 0003 1x Solar Array on Roof V A SKU: 0019 1x Warning Multiple Supplies Switchboard SKU: 0020 1x Warning Hazardous D.C. Voltage SKU: 0022 1x Main Switch Grid supply (white) SKU: 0060 1x Main Switch Inverter Supply (white) SKU: 0061 2x PV Array D.C. Isolator SKU: 0029 1x Inverter A.C. Isolator SKU: 0030 1x Inverter Location SKU: 0031 1x PV SW 100mm Dia (Sticker) SKU: 0033 1x Shutdown Procedure SKU: 0037 1x Warning Multiple D.C. Sources Equipment SKU: 0040 1x Warning PV Array DC Isolators do not de-energise the PV array and Array Cabling SKU: 0047

**PV SW System Label Kit NSW (with roof top isolators)****13 piece NSW Label Kit AS/NZ 5033:2021****SKU:****Price:** \$13.13 ex-GST**Stock:** instock**Tags:** [Kits](#), [NSW](#)**Product Description**

PV SW System Label Kit NSW (with roof top isolators) SKU: 5020 Kit Contents: 1x Solar Array on Roof V A SKU: 0019 1x Warning Multiple Supplies Switchboard SKU: 0020 1x Warning Hazardous D.C. Voltage SKU: 0022 1x Main Switch Grid supply (white) SKU: 0060 1x Main Switch Inverter Supply (white) SKU: 0061 2x PV Array D.C. Isolator SKU: 0029 1x Inverter A.C. Isolator SKU: 0030 1x Inverter Location SKU: 0031 1x PV SW Green Reflective Fire Sign 100mm Dia (Sticker) SKU: 0033 1x Shutdown Procedure SKU: 0037 1x Warning Multiple D.C. Sources Equipment SKU: 0040 1x Warning PV Array DC Isolators do not de-energise the PV array and Array Cabling SKU: 0047



PV SW System Label Kit Victoria (with roof top isolators)

14 piece VIC Label Kit AS/NZ 5033:2021

SKU: 5015

Price: \$13.13 ex-GST

Stock: instock

Tags: [Kits](#), [Victoria](#)

Product Description

PV SW System Label Kit Victoria (with roof top isolators) SKU: 5015 Kit Contents: [1x Solar Array on Roof V A SKU: 0019](#) [1x Warning Multiple Supplies Switchboard SKU: 0020](#) [1x Warning Hazardous D.C. Voltage SKU: 0022](#) [1x Main Switch Inverter Supply \(red\) SKU: 0027](#) [1x Main Switch Grid supply \(red\) SKU: 0028](#) [2x PV Array D.C. Isolator SKU: 0029](#) [1x Inverter A.C. Isolator SKU: 0030](#) [1x Inverter Location SKU: 0031](#) [1x PV SW 100mm Dia \(Sticker\) SKU: 0033](#) [1x Warning This premise contains an electricity generation system SKU: 0035](#) [1x Shutdown Procedure SKU: 0037](#) [1x Warning Multiple D.C. Sources Equipment SKU: 0040](#) [1x Warning PV Array DC Isolators do not de-energise the PV array and Array Cabling SKU: 0047](#)