



Tesla Powerwall 3 & PV Label Kit

Tesla Powerwall 3 & PV Label Kit – 3 String

SKU: T-PW3-PV-KIT

PV DP and ES3480 Sticker Default, None, PV DP and ES3480 Sticker Default, Vinyl Sticker, PV DP and ES3480 Sticker Default, Polypropylene Label (Masonry), PV DP and ES3480 Traffolyte Label, None, PV DP and ES3480 Traffolyte Label, Vinyl Sticker, PV DP and ES3480 Traffolyte Label, Polypropylene Label (Masonry)


Price: \$30.75 ex-GST

Stock: instock

Tags: [Kits](#)

Product Description

Tesla Powerwall 3 & PV Label Kit - 3 String

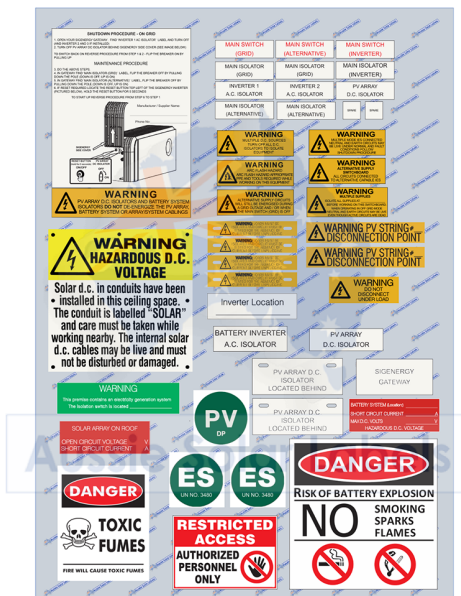

Sigenergy label kit – Three Phase

Multiple Kit options

SKU: 5150-01K00

Price: \$45.00 ex-GST

Stock: instock

Tags: [Kits](#)

Product Description

0984 1 Shutdown Procedure – On Grid 0985 1 Warning Battery System D.C. Isolators do not De-Energise the Battery 0032 1 PV DP Green Reflective Fire Sign 100mm Dia 0069 2 ES Un No: 3480 Green Reflective Fire Sign 100mm Dia 0774 1 SIGENERGY Gateway 0773 2 PV Array D.C. Isolator located behind 0821 1 Warning Multiple Supplies isolated all supplies before “Switchboard” 0156 1 Battery System Location, Short Circuit / Max D.C. Volts 0031 1 Inverter Location 0363 2 Warning PV String Disconnection Point 0716 4 Warning Loads must be isolated circuits must be tested for the absence 0780 1 Main Switch (GRID) 0781 1 Main Switch (ALTERNATIVE) 0782 1 Main Switch (INVERTER) 0772 2 Main Isolator (GRID) 0771 2 Main Isolator (ALTERNATIVE) 0783 1 Main Isolator (INVERTER) 0770 2 PV Array D.C. Isolator 0768 1 Inverter 1

A.C. Isolator 0769 1 Inverter 2 A.C. Isolator 0767 2 Spare 0131 1 Danger Toxic Fumes 0043 1 Warning Hazardous D.C. Voltage Solar D. C in conduits have been install 0129 1 Danger Risk of Battery Explosion 0287 1 Restricted Access Authorised personnel only 0752 1 Warning Do not disconnect under load 0724 1 Warning Multiple mode IES connected 0733 1 Warning ARC Flash Hazard 0035 1 Warning This Premise contains an electricity generation system 0019 1 Solar Array on roof 0812 1 Battery Inverter A.C. Isolator 0720 1 Warning Multiple DC Sources "Equipment" 0844 1 Warning Alternative Supply Circuits will still be energised 0846 1 Warning Alternative Supply Switchboard



PV SW System Label Kit NSW (with roof top isolators) with in-ceiling polypropylene label

14 piece NSW Label Kit AS/NZ 5033:2021

SKU:


Price: \$16.68 ex-GST

Stock: instock

Tags: [Kits](#), [NSW](#), [Polypropylene](#)

Product Description

PV SW System Label Kit NSW (with roof top isolators) with in-ceiling polypropylene label SKU: 5018
Kit Contents: [1x In-Ceiling Polypropylene Label \(pre-cut holes x7\)](#) SKU: 0043 [1x Solar Array on Roof V A](#) SKU: 0019 [1x Warning Multiple Supplies Switchboard](#) SKU: 0020 [1x Warning Hazardous D.C. Voltage](#) SKU: 0022 [1x Main Switch Grid supply \(white\)](#) SKU: 0060 [1x Main Switch Inverter Supply \(white\)](#) SKU: 0061 [2x PV Array D.C. Isolator](#) SKU: 0029 [1x Inverter A.C. Isolator](#) SKU: 0030 [1x Inverter Location](#) SKU: 0031 [1x PV SW Green Reflective Fire Sign 100mm Dia \(Sticker\)](#) SKU: 0033 [1x Shutdown Procedure](#) SKU: 0037 [1x Warning Multiple D.C. Sources Equipment](#) SKU: 0040 [1x Warning PV Array DC Isolators do not de-energise the PV array and Array Cabling](#) SKU: 0047

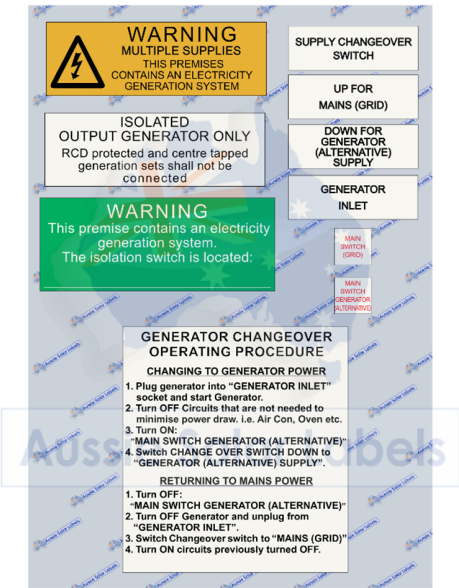

Generator LabelKit

Multiple Kit options

SKU: 5151-01 | 5152-01

Single Phase, Three Phase


Price: \$14.00 ex-GST

Stock: instock

Tags: [Kits](#)

Product Description

GENERATOR LABELKIT- SINGLE PHASE Single phase generator Change over label kit with operating instructions ASL: Sku: No: 5151-01 1005 90x100 1 Generator changeover operating procedure 1000 96x38 1 Warning this premise contains an electricity generation system 0552 90x30 1 Warning multiple supplies 0555 90x30 1 Isolated output generator only 0995 53x18 1 Supply change over switch 0996 53x18 1 Up for mains (GRID) 0997 53x18 1 Down for Generator (ALTERNATIVE) supply 0998 53x18 1 Generator inlet 0721 18x18 1 Main Switch (GRID) 0999 18x18 1 Main Switch generator (ALTERNATIVE) **GENERATOR LABELKIT- THREE PHASE** Three phase generator Change over label kit with operating instructions ASL: Sku: No: 5152-01 1005 90x100 1 Generator changeover operating procedure 1000 96x38 1 Warning this premise contains an electricity generation system 0552 90x30 1 Warning multiple supplies 0555 90x30 1 Isolated output generator only 0995 53x18 1 Supply change over switch 0996 53x18 1 Up for mains (GRID) 0997 53x18 1 Down for Generator (ALTERNATIVE) supply 0998 53x18 1 Generator inlet 0780 53x18 1 Main Switch (GRID) 1001 53x18 1 Main Switch generator (ALTERNATIVE)

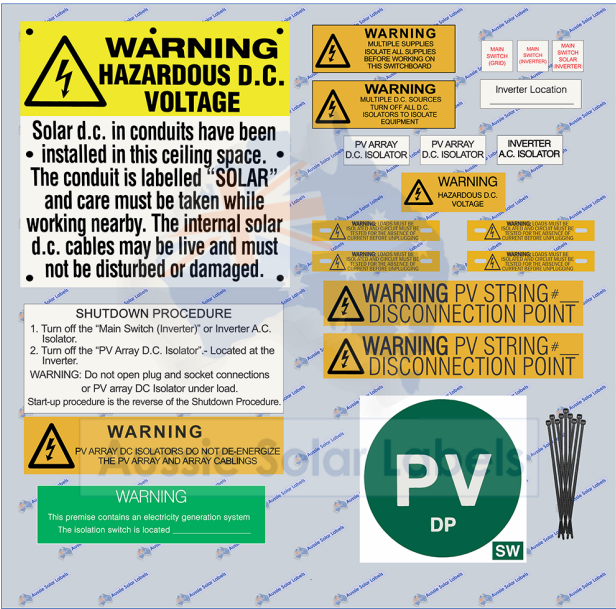

PV DP System Sticker

Multiple Kit options

SKU: 5126-01

shutdown-procedure-k sticker, none, shutdown ceiling, pv-dp-sticker, polypropylene-in-ceiling shutdown-procedure-k traffolyte-label, none, polypropylene-in-ceiling shutdown-procedure-k

traffolyte-label, polypropylene-map, shutdown-procedure-basic, traffolyte-in-ceiling, pv-dp-sticker, none, shutdown-procedure-basic, traffolyte-in-ceiling, pv-dp-sticker, vinyl-map, shutdown-procedure-basic, traffolyte-in-ceiling, pv-dp-sticker, polypropylene-map, shutdown-procedure-basic, traffolyte-in-ceiling, pv-dp-traffolyte-label, none, shutdown-procedure-basic, traffolyte-in-ceiling, pv-dp-traffolyte-label, vinyl-map, shutdown-procedure-basic, traffolyte-in-ceiling, pv-dp-traffolyte-label, polypropylene-map, shutdown-procedure-deluxe, polypropylene-in-ceiling, pv-dp-sticker, none, shutdown-procedure-deluxe, polypropylene-in-ceiling, pv-dp-sticker, vinyl-map, shutdown-procedure-deluxe, polypropylene-in-ceiling, pv-dp-sticker, polypropylene-map, shutdown-procedure-deluxe, polypropylene-in-ceiling, pv-dp-traffolyte-label, none, shutdown-procedure-deluxe, polypropylene-in-ceiling, pv-dp-traffolyte-label, vinyl-map, shutdown-procedure-deluxe, polypropylene-in-ceiling, pv-dp-traffolyte-label, polypropylene-map, shutdown-procedure-deluxe, traffolyte-in-ceiling, pv-dp-sticker, none, shutdown-procedure-deluxe, traffolyte-in-ceiling, pv-dp-sticker, vinyl-map, shutdown-procedure-deluxe, traffolyte-in-ceiling, pv-dp-sticker, polypropylene-map, shutdown-procedure-deluxe, traffolyte-in-ceiling, pv-dp-traffolyte-label, none, shutdown-procedure-deluxe, traffolyte-in-ceiling, pv-dp-traffolyte-label, vinyl-map, shutdown-procedure-deluxe, traffolyte-in-ceiling, pv-dp-traffolyte-label, polypropylene-map


Price: \$16.45 ex-GST

Stock: instock

Tags: [Kits](#)

Product Description

PV DP System Label Kit - including SW Sticker AS4777.1:2024 ASL Sku No: 5126-01 Kit Contents [table id=4 /]

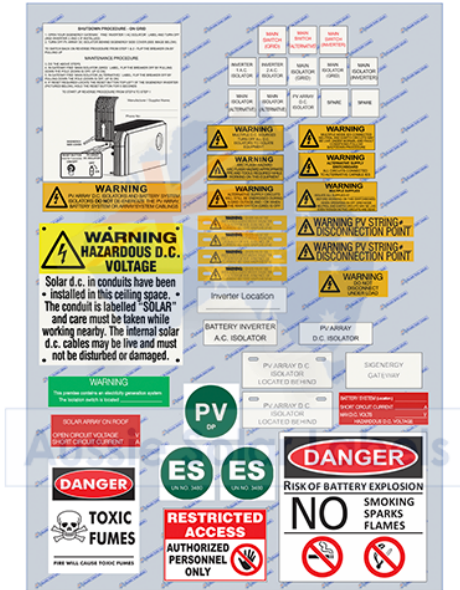

Sigenergy label kit

Multiple Kit options

SKU: 5149-01K00-1

Single Phase, Three Phase, Combined Single & Three Phase


Price: \$42.00 ex-GST

Stock: instock

Tags: [Kits](#)

Product Description

0984 1 Shutdown Procedure – On Grid 0985 1 Warning Battery System D.C. Isolators do not De-Energise the Battery 0032 1 PV DP Green Reflective Fire Sign 100mm Dia 0069 2 ES Un No: 3480 Green Reflective Fire Sign 100mm Dia 0774 1 SIGENERGY Gateway 0773 2 PV Array D.C. Isolator located behind 0821 1 Warning Multiple Supplies isolated all supplies before “Switchboard” 0156 1 Battery System Location, Short Circuit / Max D.C. Volts 0031 1 Inverter Location 0363 2 Warning PV String Disconnection Point 0716 4 Warning Loads must be isolated circuits must be tested for the absence 0721 1 Main Switch (GRID) 0727 1 Main Switch (ALTERNATIVE) 0722 1 Main Switch (INVERTER) 0731 2 Main Isolator (GRID) 0766 2 Main Isolator (ALTERNATIVE) 0784 1 Main Isolator (INVERTER) 0777 1 PV Array D.C. Isolator 0775 1 Inverter 1 A.C. Isolator 0776 1 Inverter 2 A.C. Isolator 0767 2 Spare 0131 1 Danger Toxic Fumes 0043 1 Warning Hazardous D.C. Voltage Solar D. C in conduits have been install 0129 1 Danger Risk of Battery Explosion 0287 1 Restricted Access Authorised personnel only 0752 1 Warning Do not disconnect under load 0724 1 Warning Multiple mode IES connected 0733 1 Warning ARC Flash Hazard 0035 1 Warning This Premise contains an electricity generation system 0019 1 Solar Array on roof 0770 1 PV Array D.C. Isolator 0812 1 Battery Inverter A.C. Isolator 0720 1 Warning Multiple DC Sources “Equipment” 0844 1 Warning Alternative Supply Circuits will still be energised 0846 1 Warning Alternative Supply Switchboard

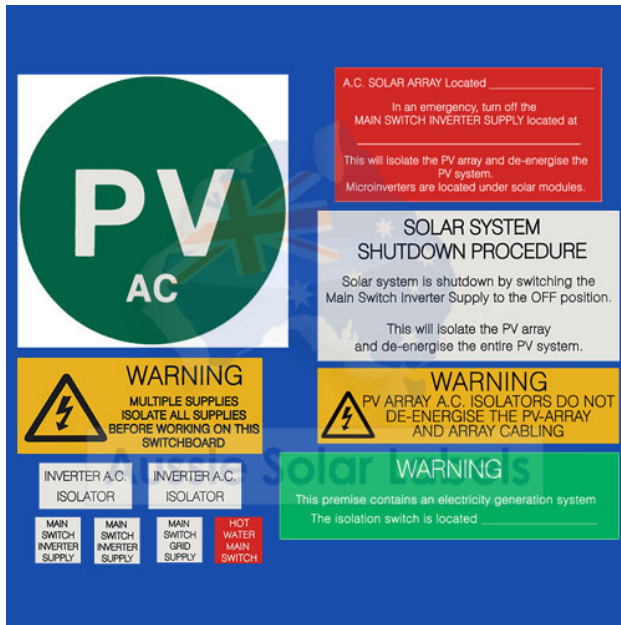

PV AC System Label Kit (microinverter)

Kit contains 12 labels

SKU: 5012


Price: \$10.77 ex-GST

Stock: instock

Tags: [Kits](#)

Product Description

PV AC System Label Kit - Microinverter Kit SKU:5012 **Kit contains 12 labels:** SKU:0020 Warning Multiple Supplies Switchboard SKU:0061 Main Switch Inverter Supply x2 SKU:0060 Main Switch Grid supply SKU:0030 Inverter A.C. Isolator x2 SKU:0054 Hot Water Main Switch SKU:0034 PV AC 100mm Dia (Sticker) SKU:0035 Warning This premise contains an electricity generation system SKU:0289 A.C. Solar Array Located (microinverter) SKU:0053 Solar System Shutdown Procedure (microinverter) SKU:0359 Warning PV Array AC Isolators Do Not de-energise the PV Array and array cabling

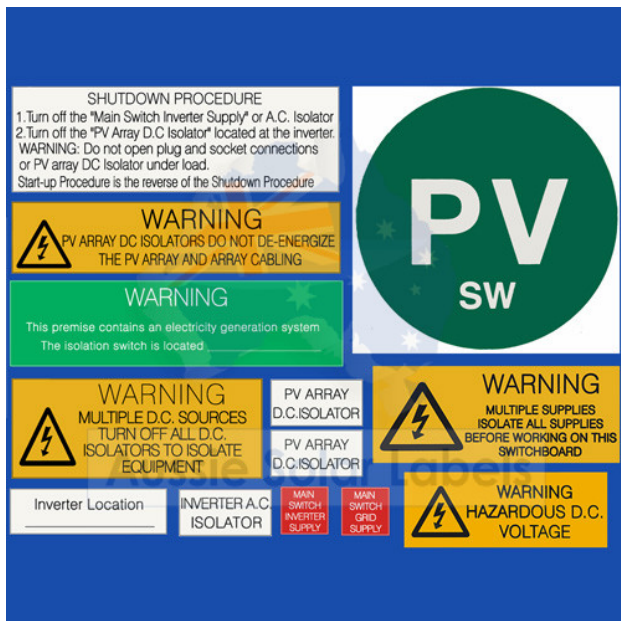

PV SW System Label Kit

Multiple Kit options and Optional PV (Solar) Site Information Map

SKU: 5015 | 5020

excluding-nsw-act, none, act-nsw, none, excluding-nsw-act, vinyl-map, act-nsw, vinyl-map, excluding-nsw-act, polypropylene-map, act-nsw, polypropylene-map

Price: \$11.15 ex-GST


Stock: instock

Tags: [ACT](#), [Kits](#), [NSW](#), [QLD](#), [SA](#), [Victoria](#), [WA](#)

Product Description

PV SW System Label Kit SKU:5015 13 piece kit (VIC, QLD, WA, SA, TAS & NT) SKU:5020 12 piece kit (ACT & NSW) **Option to add PV (Solar) Site Information Map & Icon sticker Kit** 2 piece, 250x175mm SKU:5085 Polypropylene with 4 pre-cut holes and Icons sticker set SKU:5086 Sticker(Vinyl decal) and Icons sticker set **Kit contains:** SKU:0020 Warning Multiple Supplies Switchboard SKU:0022 Warning Hazardous

D.C. Voltage SKU:0027 & SKU:0061 Main Switch Inverter Supply SKU:0028 & SKU:0060 Main Switch Grid supply SKU:0029 PV Array D.C. Isolator SKU:0030 Inverter A.C. Isolator SKU:0031 Inverter Location SKU:0033 PV SW 100mm Dia (Sticker) SKU:0035 Warning This premise contains an electricity generation system SKU:0037 Shutdown Procedure SKU:0040 Warning Multiple D.C. Sources Equipment SKU:0047 Warning PV Array DC Isolators do not de-energise the PV array and Array Cabling

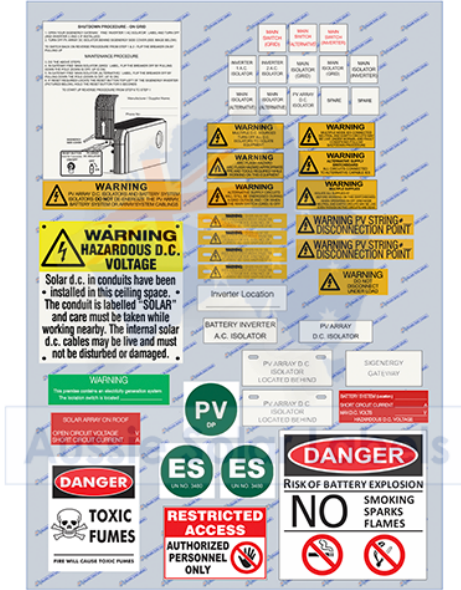

Sigenergy label kit – Single Phase

Multiple Kit options

SKU: 5149-01K00

Price: \$42.00 ex-GST

Stock: instock

Tags: [Kits](#)

Product Description

0984 1 Shutdown Procedure – On Grid 0985 1 Warning Battery System D.C. Isolators do not De-Energise the Battery 0032 1 PV DP Green Reflective Fire Sign 100mm Dia 0069 2 ES Un No: 3480 Green Reflective Fire Sign 100mm Dia 0774 1 SIGENERGY Gateway 0773 2 PV Array D.C. Isolator located behind 0821 1 Warning Multiple Supplies isolated all supplies before “Switchboard” 0156 1 Battery System Location, Short Circuit / Max D.C. Volts 0031 1 Inverter Location 0363 2 Warning PV String Disconnection Point 0716 4 Warning Loads must be isolated circuits must be tested for the absence 0721 1 Main Switch (GRID) 0727 1 Main Switch (ALTERNATIVE) 0722 1 Main Switch (INVERTER) 0731 2 Main Isolator (GRID) 0766 2 Main Isolator (ALTERNATIVE) 0784 1 Main Isolator (INVERTER) 0777 1 PV Array D.C. Isolator 0775 1 Inverter 1 A.C. Isolator 0776 1 Inverter 2 A.C. Isolator 0767 2 Spare 0131 1 Danger Toxic Fumes 0043 1 Warning Hazardous D.C. Voltage Solar D. C in conduits have been install 0129 1 Danger Risk of Battery Explosion 0287 1 Restricted Access Authorised personnel only 0752 1 Warning Do not disconnect under load 0724 1 Warning Multiple mode IES connected 0733 1 Warning ARC Flash Hazard 0035 1 Warning This Premise contains an electricity generation system 0019 1 Solar Array on roof 0770 1 PV Array D.C. Isolator 0812 1 Battery Inverter A.C. Isolator 0720 1 Warning Multiple DC Sources “Equipment” 0844 1 Warning Alternative Supply Circuits will still be energised 0846 1 Warning Alternative Supply Switchboard



Solar d.c. in conduits have been installed in this ceiling space. The conduit is labelled "SOLAR" and care must be taken while working nearby. The internal solar d.c. cables may be live and must not be disturbed or damaged.



DC Label Kit 2021 Upgrade (all States excl. ACT)

51 - 100 \$13.80 101 or 250 \$13.05 500+ Call for price

SKU: 5005


Price: \$13.18 ex-GST

Stock: instock

Tags: [Kits](#)

Product Description

DC Label Kit 2021 Upgrade (all States excl. ACT) SKU:5005 **Contents:** 1x In Ceiling space or accessible floor space Solar d.c sign 4 x Disconnection Points, with cable ties 1 x PV DP Label Dia 100mm 2 x Warning – PV String Disconnection Points

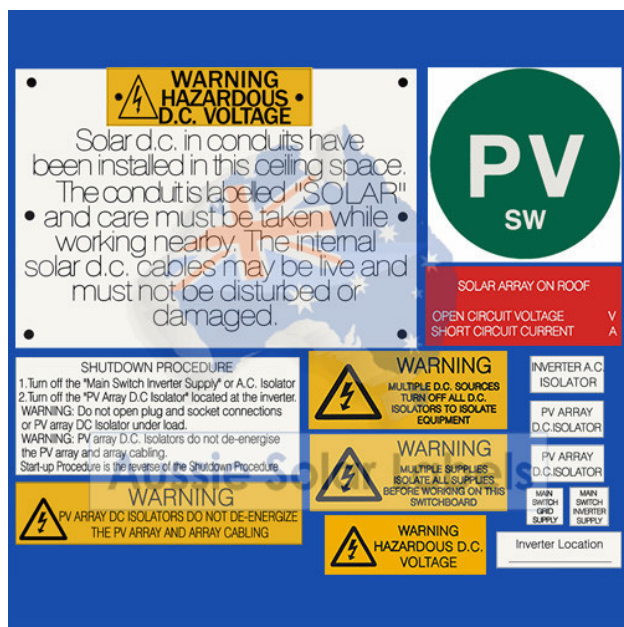

PV SW System Label Kit NSW (with roof top isolators) with in-ceiling traffolyte label

15 piece NSW Label Kit AS/NZ 5033:2021

SKU: 5019

Price: \$18.04 ex-GST

Stock: instock

Tags: [Kits](#), [NSW](#)

Product Description

PV SW System Label Kit NSW (with roof top isolators) with in-ceiling traffolyte label SKU: 5019 **Kit Contents:** 1x In-Ceiling space or accessible floor space solar d.c. in conduit (*not sold separately*) SKU: 0024 1x [Warning Hazardous DC Voltage \(pre-cut hole x2\)](#) SKU: 0003 1x [Solar Array on Roof V A](#) SKU: 0019 1x [Warning Multiple Supplies Switchboard](#) SKU: 0020 1x [Warning Hazardous D.C. Voltage](#) SKU: 0022 1x [Main Switch Grid supply \(white\)](#) SKU: 0060 1x [Main Switch Inverter Supply \(white\)](#) SKU: 0061 2x [PV Array D.C. Isolator](#) SKU: 0029 1x [Inverter A.C. Isolator](#) SKU: 0030 1x [Inverter Location](#) SKU:

[0031 1x PV SW 100mm Dia \(Sticker\) SKU: 0033 1x Shutdown Procedure SKU: 0037 1x Warning Multiple D.C. Sources Equipment SKU: 0040 1x Warning PV Array DC Isolators do not de-energise the PV array and Array Cabling SKU: 0047](#)



PV SW System Label Kit NSW (with roof top isolators)

13 piece NSW Label Kit AS/NZ 5033:2021

SKU:

Price: \$13.13 ex-GST

Stock: instock

Tags: [Kits](#), [NSW](#)

Product Description

PV SW System Label Kit NSW (with roof top isolators) SKU: 5020 Kit Contents: [1x Solar Array on Roof V A SKU: 0019](#) [1x Warning Multiple Supplies Switchboard SKU: 0020](#) [1x Warning Hazardous D.C. Voltage SKU: 0022](#) [1x Main Switch Grid supply \(white\) SKU: 0060](#) [1x Main Switch Inverter Supply \(white\) SKU: 0061](#) [2x PV Array D.C. Isolator SKU: 0029](#) [1x Inverter A.C. Isolator SKU: 0030](#) [1x Inverter Location SKU: 0031](#) [1x PV SW Green Reflective Fire Sign 100mm Dia \(Sticker\) SKU: 0033](#) [1x Shutdown Procedure SKU: 0037](#) [1x Warning Multiple D.C. Sources Equipment SKU: 0040](#) [1x Warning PV Array DC Isolators do not de-energise the PV array and Array Cabling SKU: 0047](#)